

Anniversary Date: 1-Apr-20
Published Date: 22-Jan-21

Licensee: Eurobodalla Shire Council

EPL No.: 1397

Premises: Batemans Bay Sewage Treatment Plant Address: George Bass Drive, Batemans Bay, NSW 2536

Licence Period: 1-Apr-20 to 31-Mar-21

EPL Link: https://apps.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33192&SYSUID=1&LICID=1397

POEO Public Register: https://apps.epa.nsw.gov.au/prpoeoapp/

Required Month:

Dec-20

Licence Point / Type of Point: Licence Point 1 - Discharge to Waters - Point 1 Concentration Limits				
Parameters	Unit of Measure	50 percentile	100 percentile	_
raiameters	Offit of Measure	concentration limit	concentration limit	
Biological Oxygen Demand	(mg/L)	10	20	
Oil and Grease	(mg/L)	-	10	s
Total Suspended Solids	(mg/L)	15	30	

Note 1: A 100 Percentile Concentration Limit of "10 mg/L and no visible oil and grease" applies for Point 1.

Note 2: The monitoring at Point 3, required by Condition M2.1, is conducted by the licensee to determine compliance with limits specified for discharges to Point 1 as described in Condition L3.

Licence Point / Type of Point:	Licence Point 3 - Effluent Quality Mo	onitoring					
Sample Frequency	Monthly	Special Frequency 1	Monthly	Monthly	Monthly	Monthly	
Sampling Method	Composite Sample	Grab Sample	Composite Sample	Grab Sample	Composite Sample	Composite Sample	
Parameters	Biological Oxygen Demand	Chlorophyll a	Total Nitrogen	Oil and Grease	Total Phosphorus	Total Suspended Solids	
Unit of Measure	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	
Sampled Date	Biological Oxygen Demand	Chlorophyll a	Total Nitrogen	Oil and Grease	Total Phosphorus	Total Suspended Solids	Obtained Date
1-Dec-20	<2	0.0006	3.26	<5	2.82	<2	9-Dec-20
Minimum Value	<2	0.0006	3.26	<5	2.82	<2	
Maximum Value	<2	0.0006	3.26	<5	2.82	<2	

100 Percentile - Licence Condition									
	Biological Oxygen Demand			Oil and Grease			Total Suspended Solids		
Sample Date	Measurement	Actual 100 Percentile to Sample Date	Exceedance	Measurement	Actual 100 Percentile to Sample Date	Exceedance	Measurement	Actual 100 Percentile to Sample Date	Exceedance
1-Dec-20	<2	2.00	NO	<5	5.00	NO	<2	3.00	NO

Special Frequency 1: means collect and store sample monthly, at the same time as Biochemical Oxygen Demand or Total Suspended Solids sampling. If the Biochemical Oxygen Demand or Total Suspended Solids 100 percentile concentration limit is exceeded as per condition 13.3, then analyse the stored sample for chlorophyll a and report results to the EPA as soon as the results become available.

Licensee: Eurobodalla Shire Council

EPL No.: 1397

Premises: Batemans Bay Sewage Treatment Plant Address: George Bass Drive, Batemans Bay, NSW 2536

Licence Period: 1-Apr-20 to 31-Mar-21

EPL Link: https://apps.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33192&SYSUID=1&LICID=1397

POEO Public Register: https://apps.epa.nsw.gov.au/prpoeoapp/

Licence Point / Type of Point:	Licence Point 2 - Influent Volume N	Monitoring	
Sample Frequency	Daily (Continuous)	Maximum Daily flow (kL)	25000
Sampling Method	Ultrasonic Flow Meter		
Parameter	Rainfall	Plant Inflow	Exceedance
Unit of Measure	(mm)	(kL)	(YES/NO)
Sample Date			
1-Dec-20	0	4339.7	NO
2-Dec-20	0	4220.8	NO
3-Dec-20	0	4079.9	NO
4-Dec-20	0	4214.8	NO
5-Dec-20	0	4289.9	NO
6-Dec-20	2.5	4419.8	NO
7-Dec-20	0	4449.9	NO
8-Dec-20	0.5	4331.2	NO
9-Dec-20	0	4157.8	NO
10-Dec-20	0	4170.5	NO
11-Dec-20	0	4100.0	NO
12-Dec-20	0	4147.7	NO
13-Dec-20	3	4353.3	NO
14-Dec-20	1	4359.4	NO
15-Dec-20	0	4391.4	NO
16-Dec-20	17.5	4293.5	NO
17-Dec-20	47.5	11063.1	NO
18-Dec-20	0.5	7603.7	NO
19-Dec-20	3	5390.5	NO
20-Dec-20	1	4831.0	NO
21-Dec-20	0	4902.6	NO
22-Dec-20	9.5	4874.6	NO
23-Dec-20	0.5	5667.2	NO
24-Dec-20	0.5	5038.7	NO
25-Dec-20	5	5127.5	NO
26-Dec-20	2.5	4873.8	NO
27-Dec-20	6.5	6596.4	NO
28-Dec-20	0.5	8885.8	NO
29-Dec-20	3.5	6565.3	NO
30-Dec-20	0	6471.1	NO
31-Dec-20	0	6412.3	NO
Monthly Tota	105	162623.2	
Monthly Minimur	n 0	4079.9	
Monthly Maximur	n 47.5	11063.1	



Anniversary Date:

Published Date: 22-Jan-21

1-Apr-20

Licensee: Eurobodalla Shire Council

Premises: Batemans Bay Sewage Treatment Plant Address: George Bass Drive, Batemans Bay, NSW 2536

Licence Period: 1-Apr-20 to 31-Mar-21

 $\textbf{EPL Link:} \ \underline{\text{https://apps.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33192\&SYSUID=1\&LICID=1397}$ 

POEO Public Register: https://apps.epa.nsw.gov.au/prpoeoapp/

Licence Point / Type of Point:	Licence Point 4 - Ambient Water Monitoring	
Frequency	Monthly	
Sampling Method	Grab Sample	
Parameters	Faecal Coliforms	
Unit of Measure	cfu/100 mL	
Sampled Date		Obtained Date
1-Dec-20	13	9-Dec-20
Minimum Value	13	
Maximum Value	13	

Licence Point / Type of Point:	Licence Point 5 - Ambient Water Monitoring	
Sample Frequency	Monthly	
Sampling Method	Grab Sample	
Parameters	Faecal Coliforms	
Unit of Measure	cfu/100 mL	
Sampled Date		Obtained Date
1-Dec-20	4	9-Dec-20
Minimum Value	4	
Maximum Value	4	



Anniversary Date: 1-Apr-20

Published Date: 22-Jan-21

eurobodalla shire council

Anniversary Date:

**Published Date:** 

1-Apr-20

22-Jan-21

Licensee: Eurobodalla Shire Council

LFE NO.: 1337

Premises: Batemans Bay Sewage Treatment Plant Address: George Bass Drive, Batemans Bay, NSW 2536

Licence Period: 1-Apr-20 to 31-Mar-21

EPL Link: https://apps.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33192&SYSUID=1&LICID=1397

POEO Public Register: https://apps.epa.nsw.gov.au/prpoeoapp/


	Exceedance Report					
Date	Exceedance Type	Parameter	Description / Action			
!	1	!	!			

Licensee: Eurobodalla Shire Council

Premises: Batemans Bay Sewage Treatment Plant Address: George Bass Drive, Batemans Bay, NSW 2536

31-Mar-21 1-Apr-20

 $\textbf{EPL Link:} \ \underline{\text{https://apps.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33192\&SYSUID=1\&LICID=1397}$ 

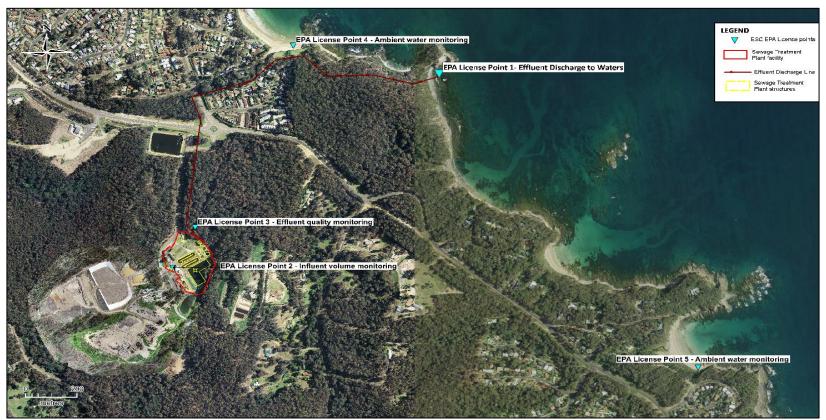



**Anniversary Date:** 1-Apr-20 **Published Date:** 

22-Jan-21